


KIWWTP Solids Processing Boiler and Heating System Upgrade

Kline's Island Wastewater Treatment Plant

Appendix D - Preliminary Boiler Room Layout

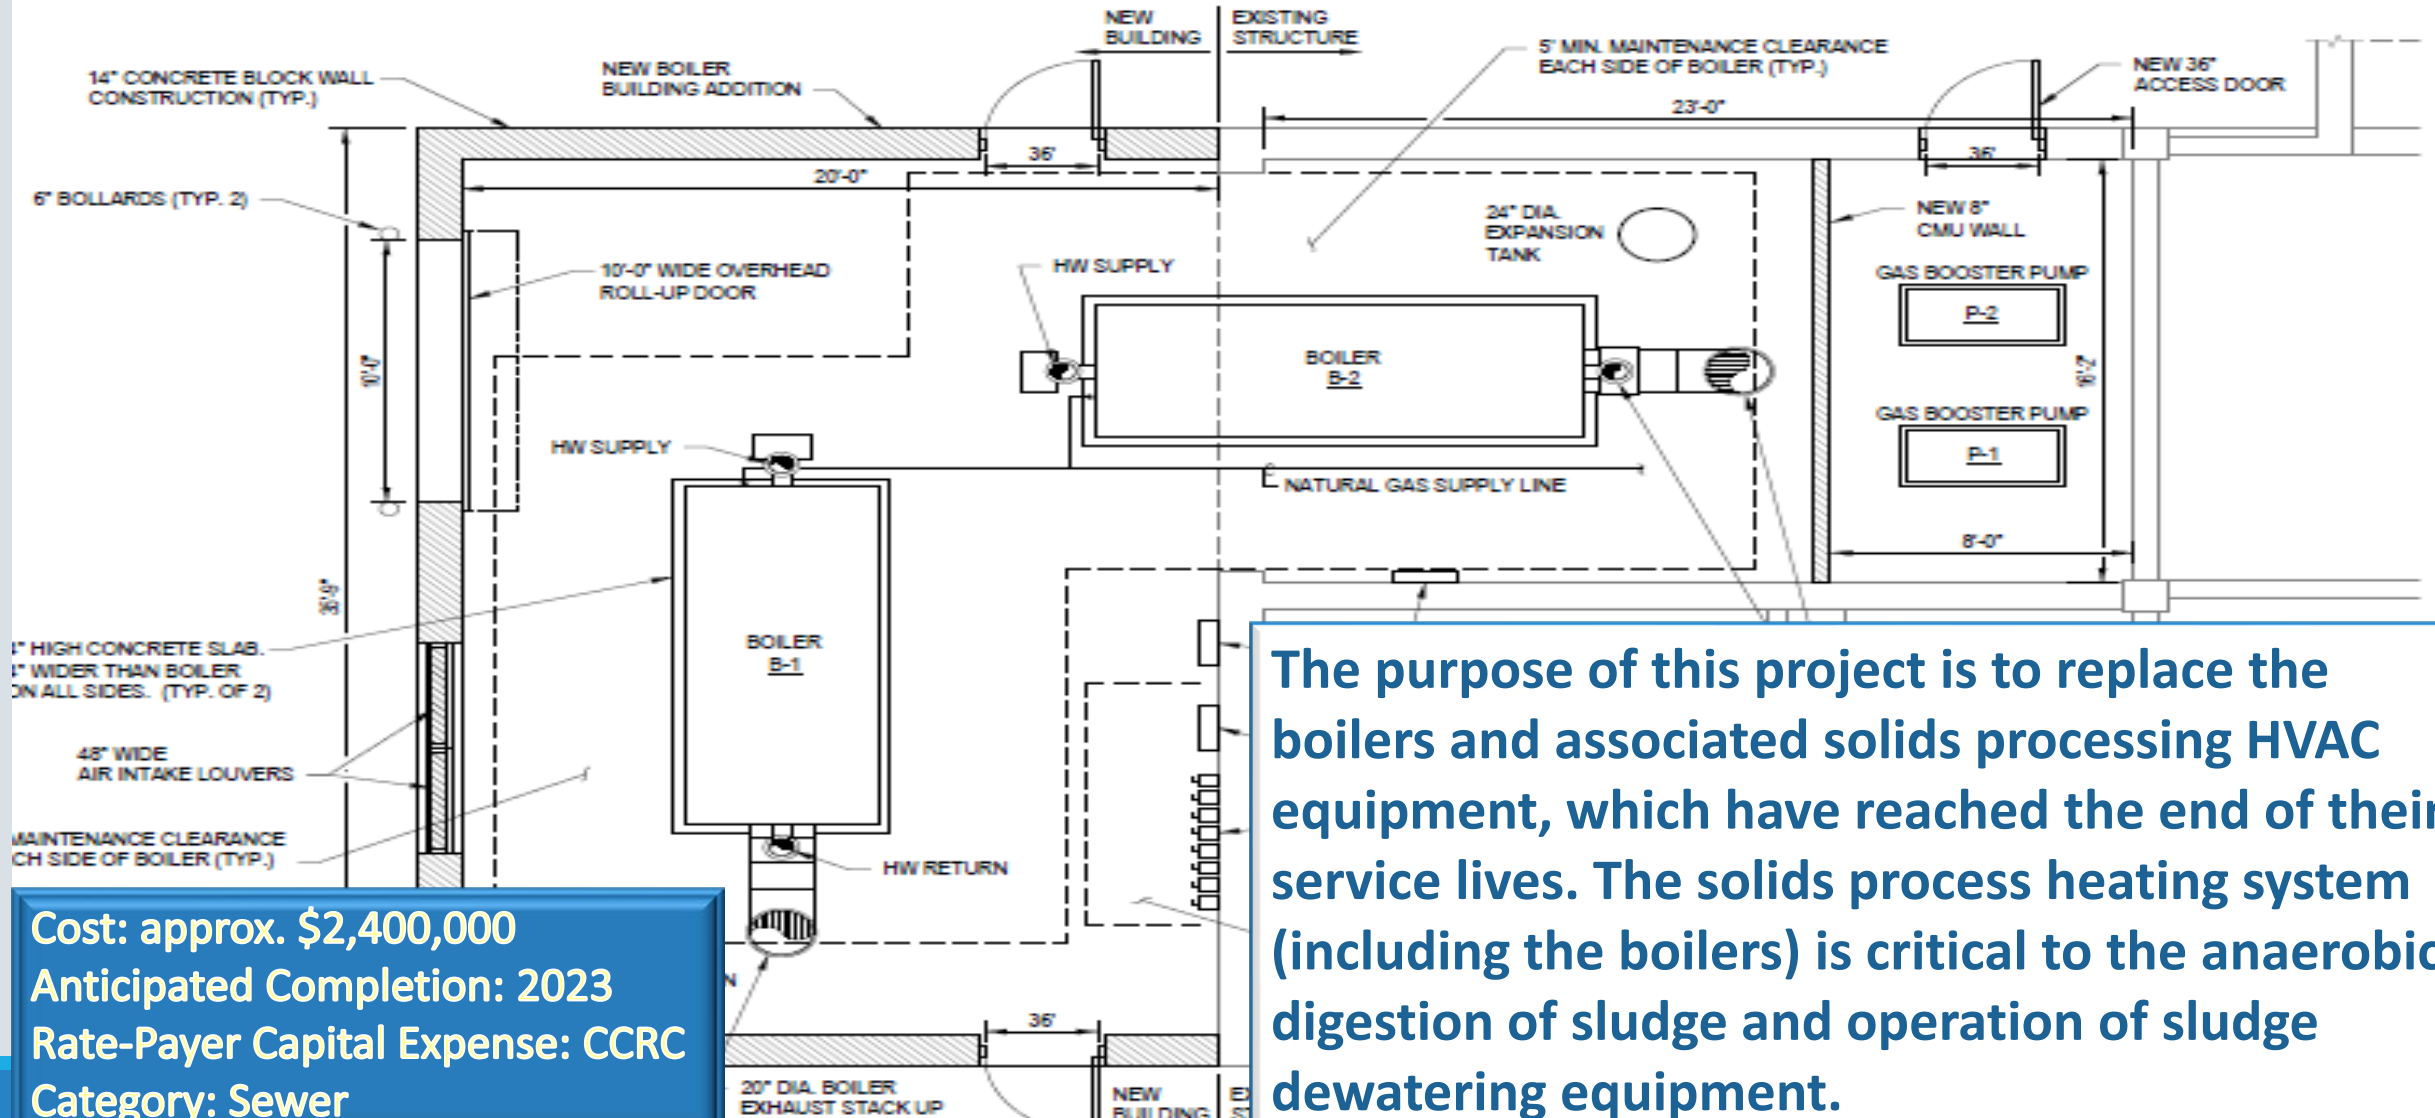

Cost: approx. \$2,400,000
Anticipated Completion: 2023
Rate-Payer Capital Expense: CCRC
Category: Sewer

The purpose of this project is to replace the boilers and associated solids processing HVAC equipment, which have reached the end of their service lives. The solids process heating system (including the boilers) is critical to the anaerobic digestion of sludge and operation of sludge dewatering equipment.